



STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	52 U-1785-01	2003	26	143


DATE	9-01	11-01
BY	M. Adams	R. Stegman
REFERENCES NOTED		
REFERENCES CHECKED		

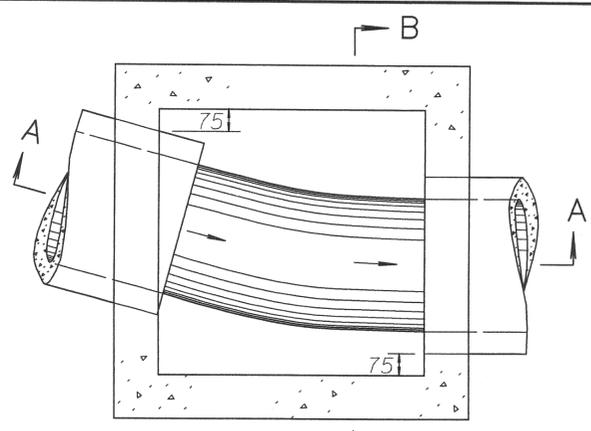

PLAN - FLOOR (Example I)

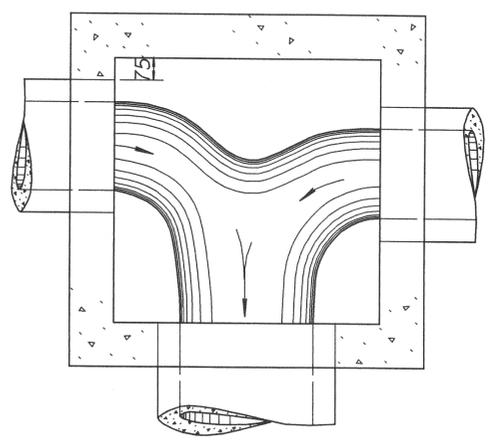


PLAN - FLOOR (Example III)

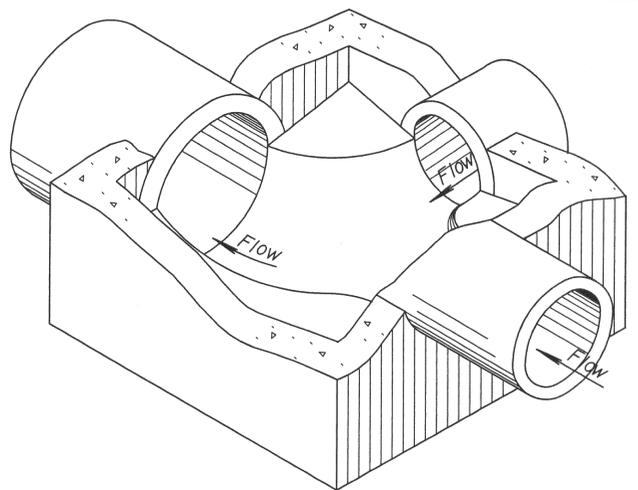


Floor of manhole shall be shaped as shown in the examples to increase hydraulic efficiency.


ISOMETRIC VIEW (Example IV)

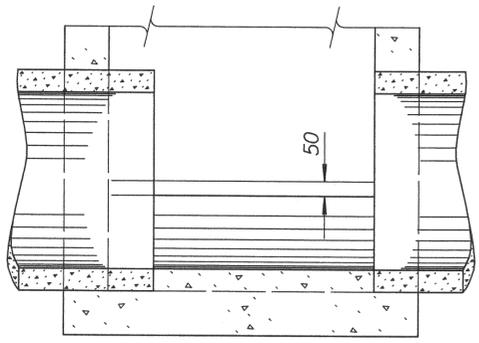


SECTION A-A (Example I)

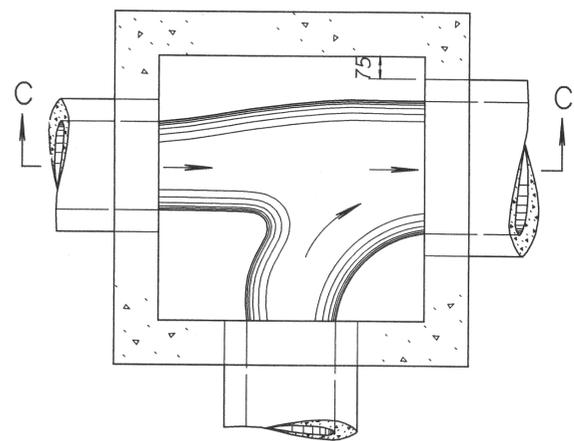


PLAN - FLOOR (Example IV)

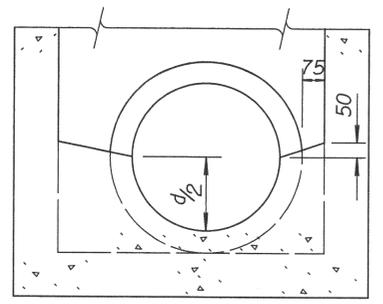


SECTION B-B (Example I)

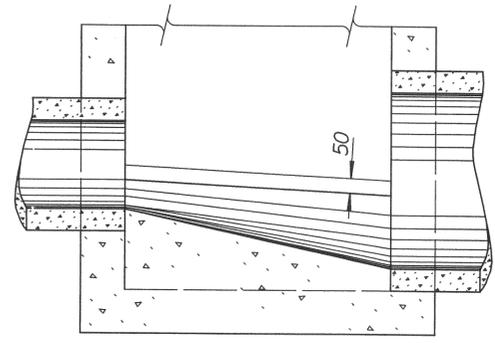

SECTION C-C (Example IV)

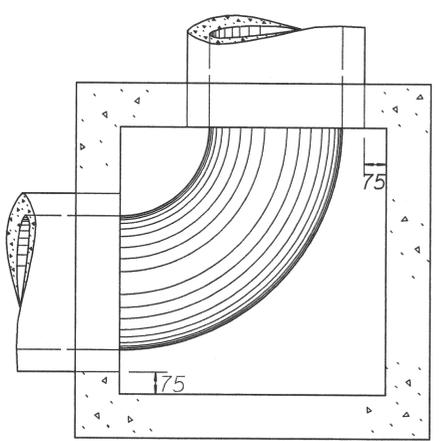


PLAN - FLOOR (Example II)

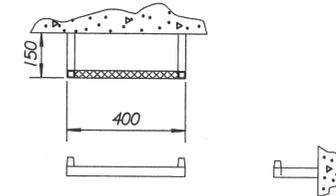


STEP DETAILS

\* Steps shall be uniformly spaced. Spacing shall be 300 mm minimum and 420 mm maximum.

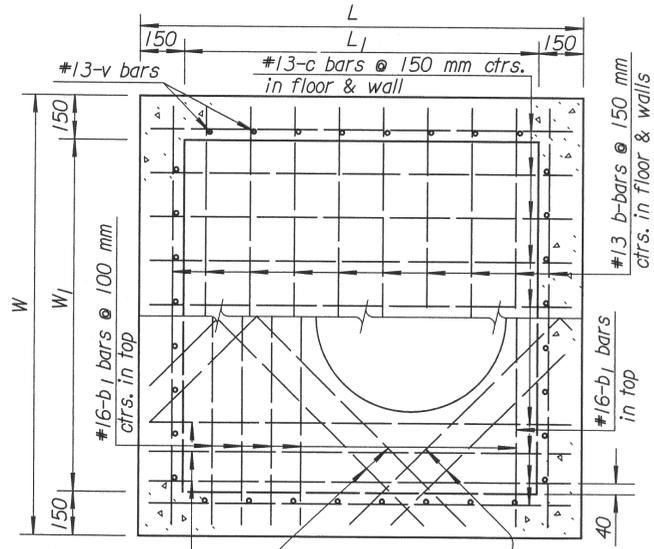


PLAN (Showing top & floor reinf.)

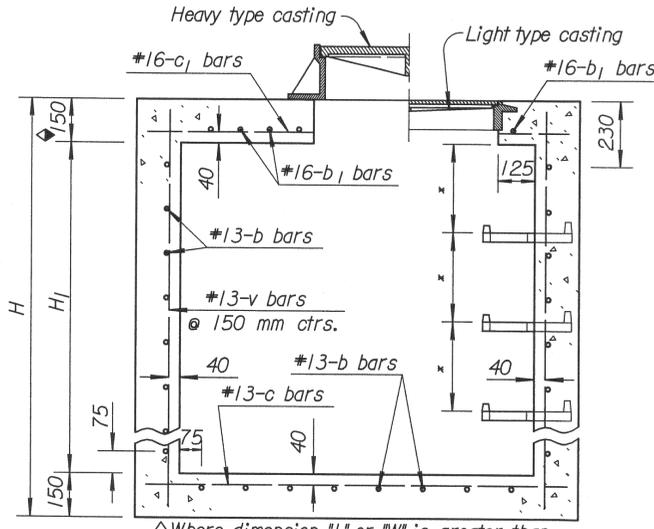




SECTION (Exclusive of floor shaping)

Where dimension "L" or "W" is greater than 1 800 mm use 200 mm slab thickness.

**GENERAL NOTES**  
 Use Grade 25 Concrete throughout. All exposed edges shall be finished with an edging tool. At the contractor's option Grade 25 Concrete (AE) or mix used in concrete pavement may be used throughout.  
 In general, pipes will enter and leave manhole at various positions. Where possible bend bars around pipes.  
 Floor of manhole shall be shaped as shown in various "EXAMPLES" with unreinforced Grade 25 Concrete. Manhole opening and steps, where used, shall be placed to afford easy access to top of shaped invert. Top reinforcing bars shall be adjusted accordingly.  
 All castings shall be gray iron and shall comply with the KDOT Standard Specifications. No deductions in concrete quantities shall be made for pipe openings or additions to concrete quantities shall be made for shaping floor of manholes.  
 The top of the manhole shall be sloped slightly to approximately fit the ground line or other condition as directed by the Engineer.  
 Dimensions and masses of cast iron as shown on this sheet are minimum. Larger dimensions and/or heavier masses of cast iron may be used.  
 The Contractor has the option of using precast manholes, as approved by the Engineer.  
 Steps shall be installed in all manholes when specified in the plans or when "H" is equal to or greater than 1 800 mm. Steps shall comply with the requirements of the KDOT Standard Specification.

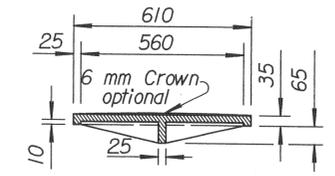


MANHOLE COVER TYPE A & B  
(Mass=61 kg; without 6 mm Crown= 57 kg)

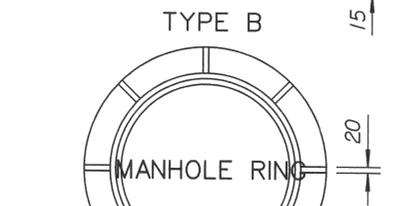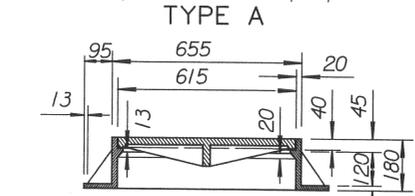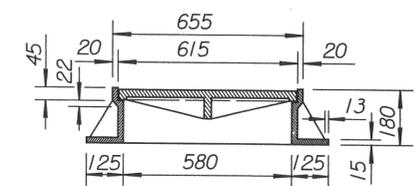


(Type A Ring= 87 kg, Type B Ring= 90 kg)

HEAVY TYPE MANHOLE COVER AND RING

Note: Either Type A or Type B may be used.

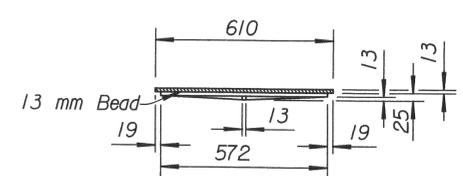

MANHOLE COVER TYPE C  
(Mass= 29 kg)

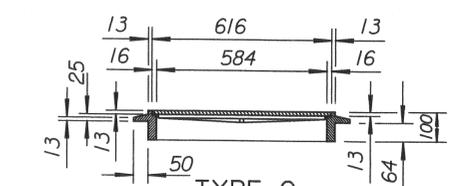

(Mass= 24 kg)

\* LIGHT TYPE MANHOLE COVER & RING

\*Rings with four equally spaced lugs will be permitted.

NO.	DATE	REVISIONS	BY	APP'D
4	4-30-02	Rev. concrete from Class to Grade.	S.W.K.	J.O.B.
3	12-16-97	Revised step spacing	R.J.S.	J.O.B.
2	9-15-97	Revised v.b. & c bar spacing	R.J.S.	J.O.B.

KANSAS DEPARTMENT OF TRANSPORTATION			
REINFORCED CONCRETE MANHOLE			
RD730 SI			
DESIGNED	5-01-02	APP'D. James O. Brewer	
DESIGN CK.	DETAIL CK.	QUANTITIES	TRACE Bowser
		QUAN. CK.	TRACE CK. Seitz

Plotted: 4/6/2004  
 Drawn By: r.stegman  
 File: p:\0154\N01541 rd730si.dgn  
 Section: \$\$\$KDOT GRP\$\$\$\$